


ROOT CAUSE ANALYSIS

MACHINE	Frequency	Duration (min)	When
Pressure Drop Compressor Accumulator Tank	2	40.75	Agustus




Document 1

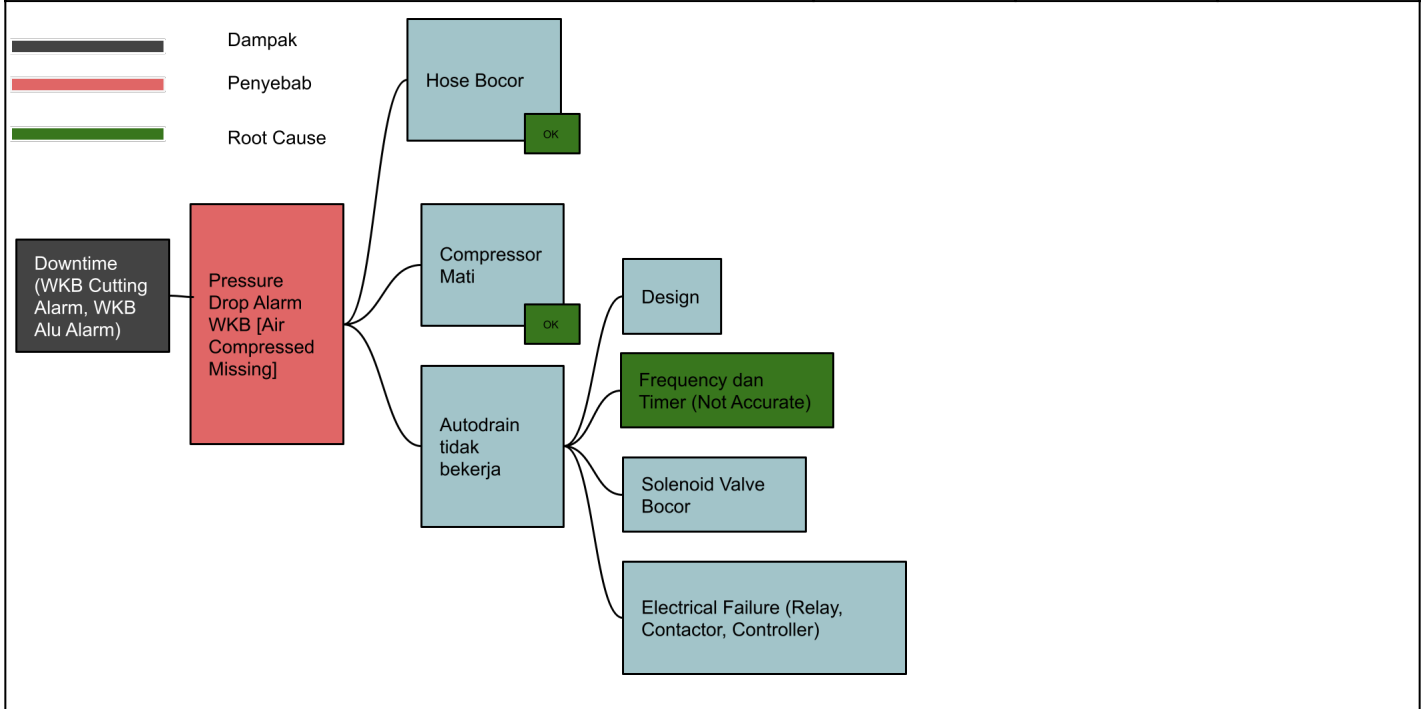

Document 2



Document 3

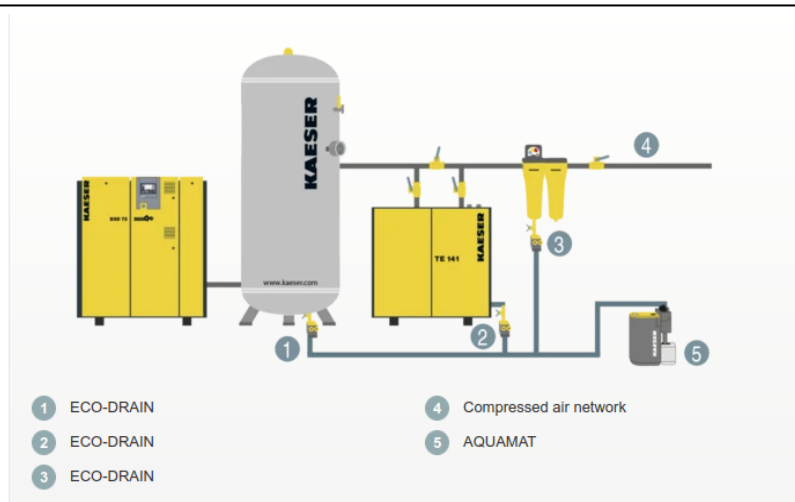

PLANNING & IMPROVEMENT					
Activity	Juli				Keterangan
	1	2	3	4	
Prepare Desain dan sparepart					Selesai
Follow up sparepart					Selesai
Installation dan commissioning program autodrain					Selesai
OBSERVASI & EVALUASI					
Activity	Agustus				Keterangan
	1	2	3	4	
Evaluasi efektifitas autodrain					Belum efektif, masih terjadi downtime
Cek Akumulasi autodrain auto (liter/accumulation 24 jam)					
Compare Kandungan air pada auto drain No 1 output accumulator tank, No 2 output dryer, No 3 output filter					
STANDARDIZATION					
Procedure	Agustus				Keterangan
	1	2	3	4	
Check List PM					On progress
Check List ketika terjadi Pressure Drop					On Progress